



中国国家强制性产品认证证书

证书编号：2024010304707491

认证委托人名称及地址

Rockwell Automation, Inc.

1201 South Second Street, Milwaukee, WI 53204, USA

生产者名称及地址

Rockwell Automation, Inc.

1201 South Second Street, Milwaukee, WI 53204, USA

生产企业名称及地址

ABB Electrification Sweden AB, Motor Starting & Safety

Motorgrand 20, 72161 Vasteras, Sweden

产品名称和系列、型号、规格

接触器

100-E400E, 460E...; 100S-E400E, 460E...; 300-GOE..., 300S-GOE...; CA9-400-EI, 460-EI...; 详见附页

产品标准和技术要求

GB/T 14048.4-2020

上述产品符合《强制性产品认证实施规则 低压电器 低压元器件》
(CNCA-C03-02:2024)的要求，特发此证。

发证日期：2024年10月22日 有效期至：2029年06月26日

证书信息和有效性可扫描下方二维码或登录发证机构网站查验，
也可在认监委网站（www.cnca.gov.cn）查询。



签发：

谢肇煦



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

中国质量认证中心有限公司





中国国家强制性产品认证证书

证书编号: 2024010304707491

证书附页: 第 1 页 共 7 页

Ui:1000V;

Uimp:8kV;

Ith: 100-E400E, 100S-E400E, CA9-400-EI:600A ,

100-E460E, 100S-E460E,300-GOE...,300S-GOE..., CA9-460-EI:700A;

100-E400E, 100S-E400E, CA9-400-EI:

Ue/Ie:

AC-3: 220-240V/230V/380-400V/415V/440V/400A, 660-690V/350A,1000V/155A;

AC-1: 415V/690V/1000V/600A;

AC-4: 500V/307A,690V/313A,1000V/141A;

100-E460E, 100S-E460E,300-GOE...,300S-GOE..., CA9-460-EI:

Ue/Ie:

AC-3: 220-240V/230V/380-400V/415V/440V/460A, 660-690V/400A,1000V/200A;

AC-1: 415V/690V/1000V/700A;

AC-4: 500V/377A, 690V/350A, 1000V/155A;

极数: 3P;

Us:100-250VAC/DC,48-130VAC/DC,24-60VDC, 250-500VAC/DC (50/60Hz);

配用辅助触头:

100-ES3-11(1NO1NC),100-ES4-11(1NO1NC),

CA9-S3-11(1NO1NC),CA9-S4-11(1NO1NC)

Ith:16A;

AC-15:Ue/Ie:AC24-127V/6A,AC220-240V/4A,

AC280-440V/3A,AC500-690V/2A;

DC-13:Ue/Ie:DC24V/6A,DC48V/2.8A,DC72V/1A,

DC125V/0.55A,DC250V/0.3A;

100-ES3-B01(1NC),CA9-S3-B01(1NC),

100S-ES3-B01(1NC),100-ES3-B10(1NO),CA9-S3-B10(1NO)

Ith:0.1A;

本页为证书附页, 应与证书主页同时使用。



中国质量认证中心

CHINA QUALITY CERTIFICATION CENTRE

中国质量认证中心有限公司



中国国家强制性产品认证证书

证书编号: 2024010304707491

证书附页: 第 2 页 共 7 页

AC-14:Ue/Ie:24-125V/0.1A;

DC-12:Ue/Ie:24-110V/0.1A

本页为证书附页, 应与证书主页同时使用。



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

中国质量认证中心有限公司



中国国家强制性产品认证证书

证书编号: 2024010304707491

证书附页: 第 3 页 共 7 页

1. 型号的解释(Explanation of Catalog No.):

<u>100-E</u>	<u>400</u>	<u>E</u>	<u>D</u>	<u>11</u>
1	2	3	4	5

1 Name of series

100-E	IEC Standard Contactor for "Allen-Bradley"
100S-E	IEC Safety Contactor for "Allen-Bradley"

2 Size of contactor

400
460

3 Coil Control

E	With PLC control input
---	------------------------

4 Coil voltage code

J	24-60VDC
Y	48-130VAC/VDC
D	100-250VAC/VDC
N	250-500VAC/VDC

5 Number of auxiliary contacts

00	Without auxiliary contacts
11	1 NO- and 1 NC-contact (1 side-mounted auxiliary contact Cat. No. 100-ES...-11)
22	2 NO- and 2 NC-contacts (2 side-mounted auxiliary contacts Cat. No. 100-ES...-11)
12C	1 NO- and 2 NC-contacts (1 side mounted auxiliary contact Cat. No. 100-ES...-11 and 1 side mounted auxiliary contact Cat. No. 100S-ES...-B01)
23C	2 NO- and 3 NC-contacts (2 side mounted auxiliary contacts Cat. No. 100-ES...-11 and 1 side mounted auxiliary contact Cat. No. 100S-ES...-B01)

00, 11, 22 used for Standard Contactors; 12C, 23C used for Safety Contactors

本页为证书附页, 应与证书主页同时使用。



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

中国质量认证中心有限公司



中国国家强制性产品认证证书

证书编号：2024010304707491

证书附页：第 4 页 共 7 页

本页为证书附页，应与证书主页同时使用。



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

中国质量认证中心有限公司



中国国家强制性产品认证证书

证书编号: 2024010304707491

证书附页: 第 5 页 共 7 页

300 - G O E D 9311
1 2 3 4 5 6

1 Name of series

300 NEMA Contactor for "Allen-Bradley"
300S NEMA Safety Contactor for "Allen-Bradley"

2 Size of contactor

G NEMA Size 6

3 Type of contactor

O Open type

4 Coil Control

E With PLC control input

5 Coil voltage code

J 24-60VDC
Y 48-130VAC/VDC
D 100-250VAC/VDC
N 250-500VAC/VDC

6 Number of auxiliary contacts

9311 1 NO- and 1 NC-contact (1 side-mounted auxiliary contact Cat. No. 100-ES...-11)
9322 2 NO- and 2 NC-contacts (2 side-mounted auxiliary contacts Cat. No. 100-ES...-11)
9312C 1 NO- and 1 NC-contacts for Safety Contactors
12C 1 NO- and 2 NC-contacts (1 side mounted auxiliary contact Cat. No. 100-ES...-11 and 1 side mounted auxiliary contact Cat. No. 100S-ES...-B01)
13C 1 NO- and 3 NC-contacts (1 side mounted auxiliary contact Cat. No. 100-ES...-11, 1 side mounted auxiliary contact Cat. No. 100-ES...-B01 and 1 side mounted auxiliary contact Cat. No. 100S-ES...-B01)

本页为证书附页, 应与证书主页同时使用。



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

中国质量认证中心有限公司



中国国家强制性产品认证证书

证书编号: 2024010304707491

证书附页: 第 6 页 共 7 页

23C

2 NO- and 3 NC-contacts (2 side mounted auxiliary contacts Cat. No. 100-ES...-11 and 1 side mounted auxiliary contact Cat. No. 100S-ES...-B01)

24C

2 NO- and 3 NC-contacts (2 side mounted auxiliary contacts Cat. No. 100-ES...-11 and 1 side mounted auxiliary contact Cat. No. 100S-ES...-B01)

9311, 9322 used for Standard Contactors; 12C, 13C, 23C, 24C used for Safety Contactors

本页为证书附页, 应与证书主页同时使用。



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

中国质量认证中心有限公司



中国国家强制性产品认证证书

证书编号: 2024010304707491

证书附页: 第 7 页 共 7 页

CA9 - 400 - EI - 11 - 120W
1 2 3 4 5

1 Name of series

CA9 IEC Standard Contactor for "Sprecher + Schuh"

2 Size of contactor

400

460

3 Coil Control

EI With PLC control input

4 Number of auxiliary contacts

00 Without auxiliary contacts

11 1 NO- and 1 NC-contact (1 side-mounted auxiliary contact Cat. No. CA9-S...-11)

22 2 NO- and 2 NC-contacts (2 side-mounted auxiliary contacts Cat. No. CA9-S...-11)

5 Coil voltage code

24W 24-60VDC

48W 48-130VAC/VDC

120W 100-250VAC/VDC

480W 250-500VAC/VDC

本页为证书附页，应与证书主页同时使用。



中国质量认证中心

CHINA QUALITY CERTIFICATION CENTRE

中国质量认证中心有限公司



CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION

本翻译文件不具有法律效力，
不得单独使用
This translated document
does not have legal validity and
cannot be used in isolation

CERTIFICATE NO.: 2024010304707491

NAME AND ADDRESS OF THE APPLICANT

Rockwell Automation, Inc.
1201 South Second Street, Milwaukee, WI 53204, USA

NAME AND ADDRESS OF THE MANUFACTURER

Rockwell Automation, Inc.
1201 South Second Street, Milwaukee, WI 53204, USA

NAME AND LOCATION OF THE FACTORY

ABB Electrification Sweden AB, Motor Starting & Safety
Motorgrand 20, 72161 Vasteras, Sweden

PRODUCT NAME,MODEL AND SPECIFICATION

Contactor
100-E400E, 460E...; 100S-E400E, 460E...; 300-GOE..., 300S-GOE...; CA9-400-EI, 460-EI...;
Refer to the appendix

STANDARDS AND TECHNICAL REQUIREMENTS FOR THE PRODUCTS

GB/T 14048.4-2020

This is to certify that the above mentioned product(s) complies with the requirements of
implementation rules for compulsory certification(REFNO. CNCA-C03-02:2024).

Valid from: Oct.22,2024

Valid until: Jun.26,2029

The certificate information and validity could be checked by scanning the QR code below or logging in to
the website of the issuing authority, or on the website of the CNCA (www.cnca.gov.cn).



SIGNATURE:

谢肇煦



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

CHINA QUALITY CERTIFICATION CENTRE CO., LTD.





CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION

本翻译文件不具有法律效力，
不得单独使用
This translated document
does not have legal validity and
cannot be used in isolation

CERTIFICATE NO. : 2024010304707491

Appendix : Page 1 of 7

Ui:1000V;

Uimp:8kV;

Ith: 100-E400E, 100S-E400E, CA9-400-EI:600A ,

100-E460E, 100S-E460E,300-GOE...,300S-GOE..., CA9-460-EI:700A;

100-E400E, 100S-E400E, CA9-400-EI:

Ue/Ie:

AC-3: 220-240V/230V/380-400V/415V/440V/400A, 660-690V/350A,1000V/155A;

AC-1: 415V/690V/1000V/600A;

AC-4: 500V/307A,690V/313A,1000V/141A;

100-E460E, 100S-E460E,300-GOE...,300S-GOE..., CA9-460-EI:

Ue/Ie:

AC-3: 220-240V/230V/380-400V/415V/440V/460A, 660-690V/400A,1000V/200A;

AC-1: 415V/690V/1000V/700A;

AC-4: 500V/377A, 690V/350A, 1000V/155A;

3P;

Us:100-250VAC/DC,48-130VAC/DC,24-60VDC, 250-500VAC/DC (50/60Hz);

Auxiliary contacts:

100-ES3-11(1NO1NC),100-ES4-11(1NO1NC),

CA9-S3-11(1NO1NC),CA9-S4-11(1NO1NC)

Ith:16A;

AC-15:Ue/Ie:AC24-127V/6A,AC220-240V/4A,

AC280-440V/3A,AC500-690V/2A;

DC-13:Ue/Ie:DC24V/6A,DC48V/2.8A,DC72V/1A,

DC125V/0.55A,DC250V/0.3A;

100-ES3-B01(1NC),CA9-S3-B01(1NC),

100S-ES3-B01(1NC),100-ES3-B10(1NO),CA9-S3-B10(1NO)

Ith:0.1A;

This page is attached to the certificate and should be used at the same time as the certificate page.



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

CHINA QUALITY CERTIFICATION CENTRE CO., LTD.



CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION


CERTIFICATE NO. : 2024010304707491

Appendix : Page 2 of 7

AC-14:Ue/Ie:24-125V/0.1A;

DC-12:Ue/Ie:24-110V/0.1A

本翻译文件不具有法律效力，
不得单独使用
This translated document
does not have legal validity and
cannot be used in isolation

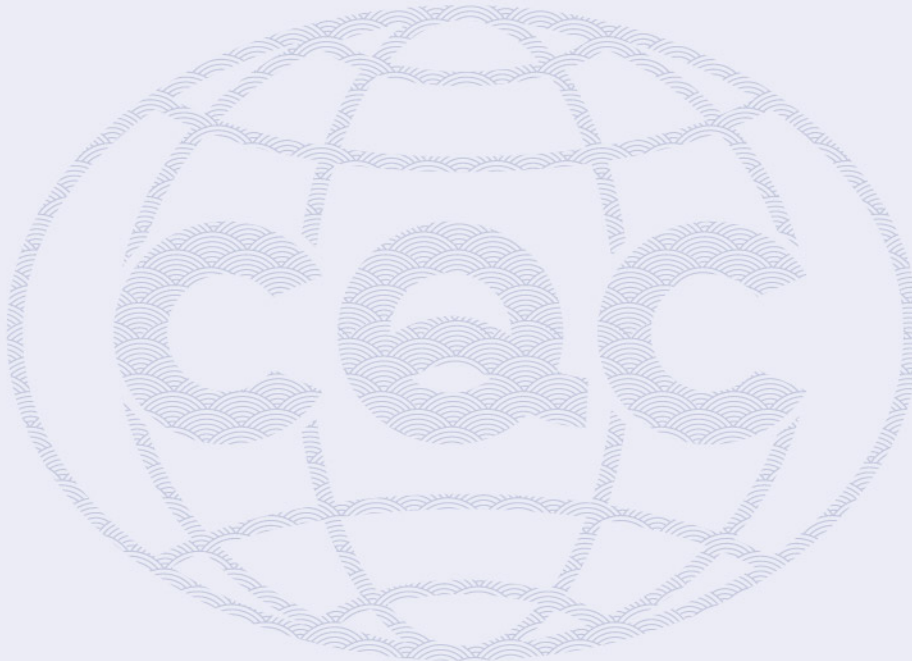

This page is attached to the certificate and should be used at the same time as the certificate page.



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

CHINA QUALITY CERTIFICATION CENTRE CO., LTD.



CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION

CERTIFICATE NO. : 2024010304707491

Appendix : Page 3 of 7

本翻译文件不具有法律效力，
不得单独使用
This translated document
does not have legal validity and
cannot be used in isolation

1. 型号的解释(Explanation of Catalog No.):

<u>100-E</u>	<u>400</u>	<u>E</u>	<u>D</u>	<u>11</u>
1	2	3	4	5

1 Name of series

100-E	IEC Standard Contactor for "Allen-Bradley"
100S-E	IEC Safety Contactor for "Allen-Bradley"

2 Size of contactor

400
460

3 Coil Control

E	With PLC control input
---	------------------------

4 Coil voltage code

J	24-60VDC
Y	48-130VAC/VDC
D	100-250VAC/VDC
N	250-500VAC/VDC

5 Number of auxiliary contacts

00	Without auxiliary contacts
11	1 NO- and 1 NC-contact (1 side-mounted auxiliary contact Cat. No. 100-ES...-11)
22	2 NO- and 2 NC-contacts (2 side-mounted auxiliary contacts Cat. No. 100-ES...-11)
12C	1 NO- and 2 NC-contacts (1 side mounted auxiliary contact Cat. No. 100-ES...-11 and 1 side mounted auxiliary contact Cat. No. 100S-ES...-B01)
23C	2 NO- and 3 NC-contacts (2 side mounted auxiliary contacts Cat. No. 100-ES...-11 and 1 side mounted auxiliary contact Cat. No. 100S-ES...-B01)

00, 11, 22 used for Standard Contactors; 12C, 23C used for Safety Contactors

This page is attached to the certificate and should be used at the same time as the certificate page.



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

CHINA QUALITY CERTIFICATION CENTRE CO., LTD.




CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION

CERTIFICATE NO. : 2024010304707491

Appendix : Page 4 of 7

本翻译文件不具有法律效力，
不得单独使用
This translated document
does not have legal validity and
cannot be used in isolation

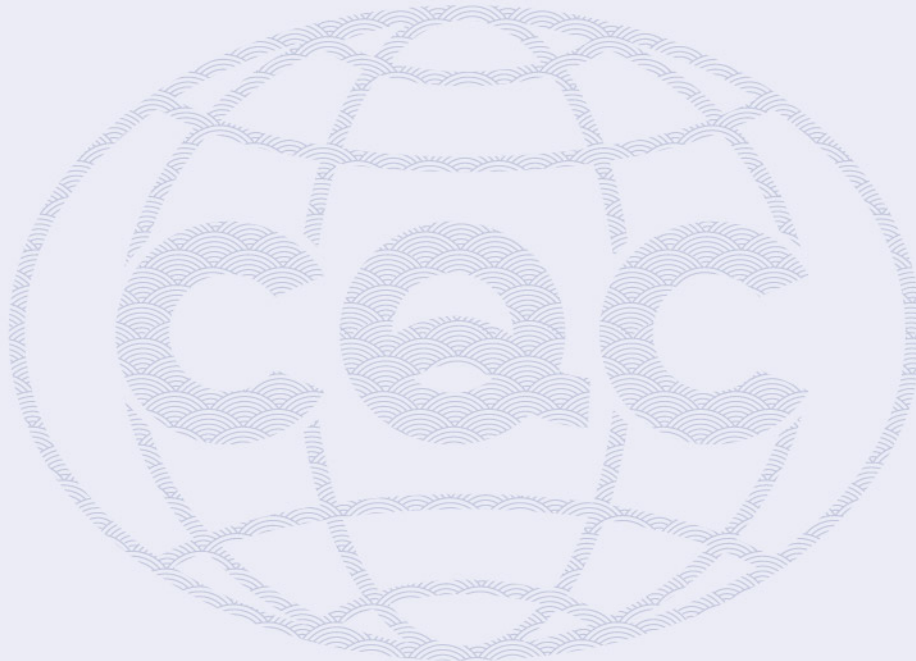

This page is attached to the certificate and should be used at the same time as the certificate page.



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

CHINA QUALITY CERTIFICATION CENTRE CO., LTD.



CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION

CERTIFICATE NO. : 2024010304707491

Appendix : Page 5 of 7

<u>300</u>	-	<u>G</u>	<u>O</u>	<u>E</u>	<u>D</u>	<u>9311</u>
1		2	3	4	5	6

1 Name of series

300	NEMA Contactor for "Allen-Bradley"
300S	NEMA Safety Contactor for "Allen-Bradley"

2 Size of contactor

G	NEMA Size 6
---	-------------

3 Type of contactor

O	Open type
---	-----------

4 Coil Control

E	With PLC control input
---	------------------------

5 Coil voltage code

J	24-60VDC
Y	48-130VAC/VDC
D	100-250VAC/VDC
N	250-500VAC/VDC

6 Number of auxiliary contacts

9311	1 NO- and 1 NC-contact (1 side-mounted auxiliary contact Cat. No. 100-ES...-11)
9322	2 NO- and 2 NC-contacts (2 side-mounted auxiliary contacts Cat. No. 100-ES...-11)
9312C	1 NO- and 1 NC-contacts for Safety Contactors
12C	1 NO- and 2 NC-contacts (1 side mounted auxiliary contact Cat. No. 100-ES...-11 and 1 side mounted auxiliary contact Cat. No. 100S-ES...-B01)
13C	1 NO- and 3 NC-contacts (1 side mounted auxiliary contact Cat. No. 100-ES...-11, 1 side mounted auxiliary contact Cat. No. 100-ES...-B01 and 1 side mounted auxiliary contact Cat. No. 100S-ES...-B01)

This page is attached to the certificate and should be used at the same time as the certificate page.



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

CHINA QUALITY CERTIFICATION CENTRE CO., LTD.

本翻译文件不具有法律效力，
不得单独使用
This translated document
does not have legal validity and
cannot be used in isolation



CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION


本翻译文件不具有法律效力，
不得单独使用
This translated document
does not have legal validity and
cannot be used in isolation

CERTIFICATE NO. : 2024010304707491

Appendix : Page 6 of 7

23C	2 NO- and 3 NC-contacts (2 side mounted auxiliary contacts Cat. No. 100-ES...-11 and 1 side mounted auxiliary contact Cat. No. 100S-ES...-B01)
24C	2 NO- and 3 NC-contacts (2 side mounted auxiliary contacts Cat. No. 100-ES...-11 and 1 side mounted auxiliary contact Cat. No. 100S-ES...-B01)

9311, 9322 used for Standard Contactors; 12C, 13C, 23C, 24C used for Safety Contactors

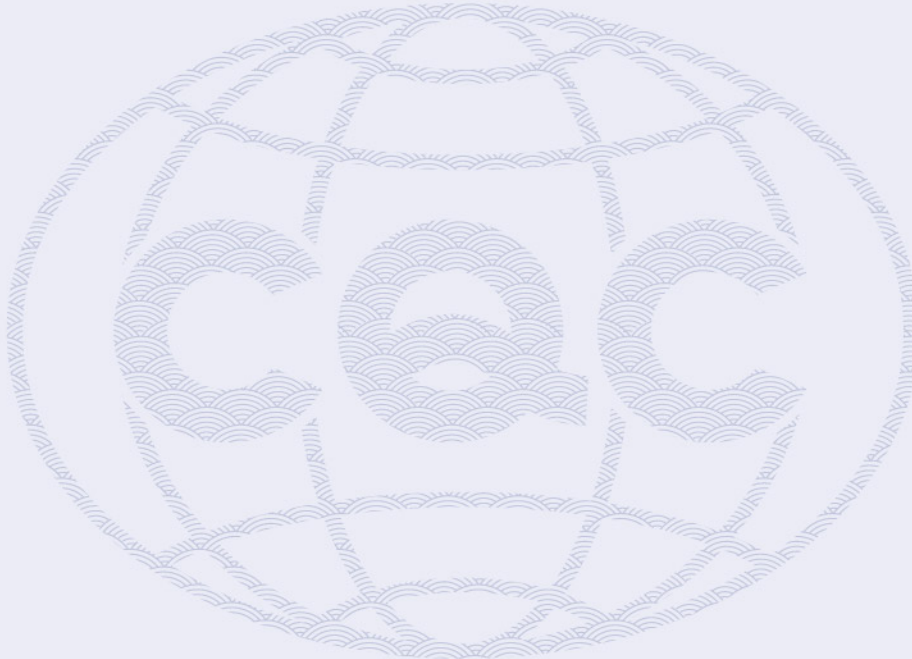

This page is attached to the certificate and should be used at the same time as the certificate page.



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

CHINA QUALITY CERTIFICATION CENTRE CO., LTD.



CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION

CERTIFICATE NO. : 2024010304707491

Appendix : Page 7 of 7

CA9 - 400 - EI - 11 - 120W
1 2 3 4 5

1 Name of series

CA9 IEC Standard Contactor for "Sprecher + Schuh"

2 Size of contactor

400

460

3 Coil Control

EI With PLC control input

4 Number of auxiliary contacts

00 Without auxiliary contacts

11 1 NO- and 1 NC-contact (1 side-mounted auxiliary contact Cat. No. CA9-S...-11)

22 2 NO- and 2 NC-contacts (2 side-mounted auxiliary contacts Cat. No. CA9-S...-11)

5 Coil voltage code

24W 24-60VDC

48W 48-130VAC/VDC

120W 100-250VAC/VDC

480W 250-500VAC/VDC

This page is attached to the certificate and should be used at the same time as the certificate page.



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

CHINA QUALITY CERTIFICATION CENTRE CO., LTD.

本翻译文件不具有法律效力，
不得单独使用
This translated document
does not have legal validity and
cannot be used in isolation