
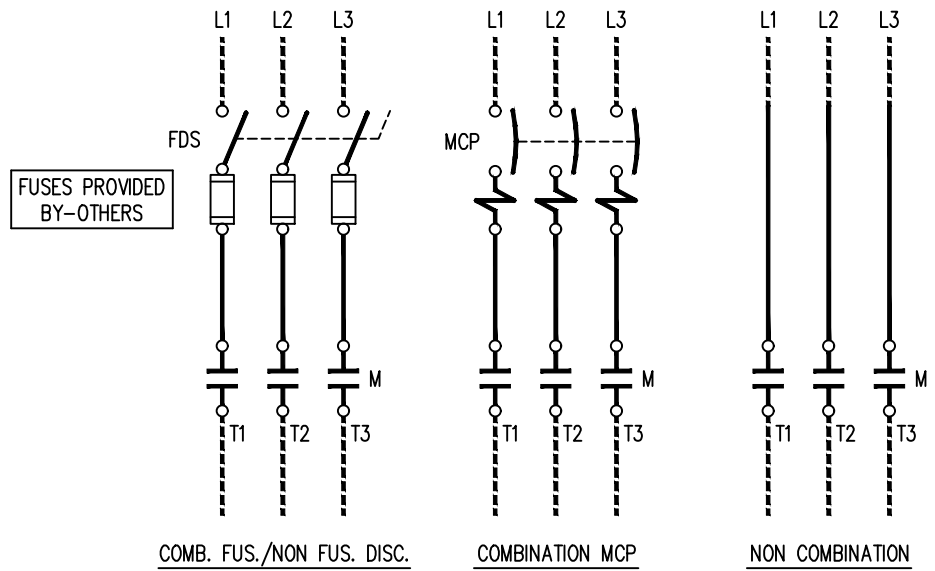


WARNING
 MOTOR CONTROL CIRCUIT DISCONNECTING
 MEANS ARE REMOTELY LOCATED
 MAX. PROTECTIVE DEVICE AMP RATING: 10 AMPS

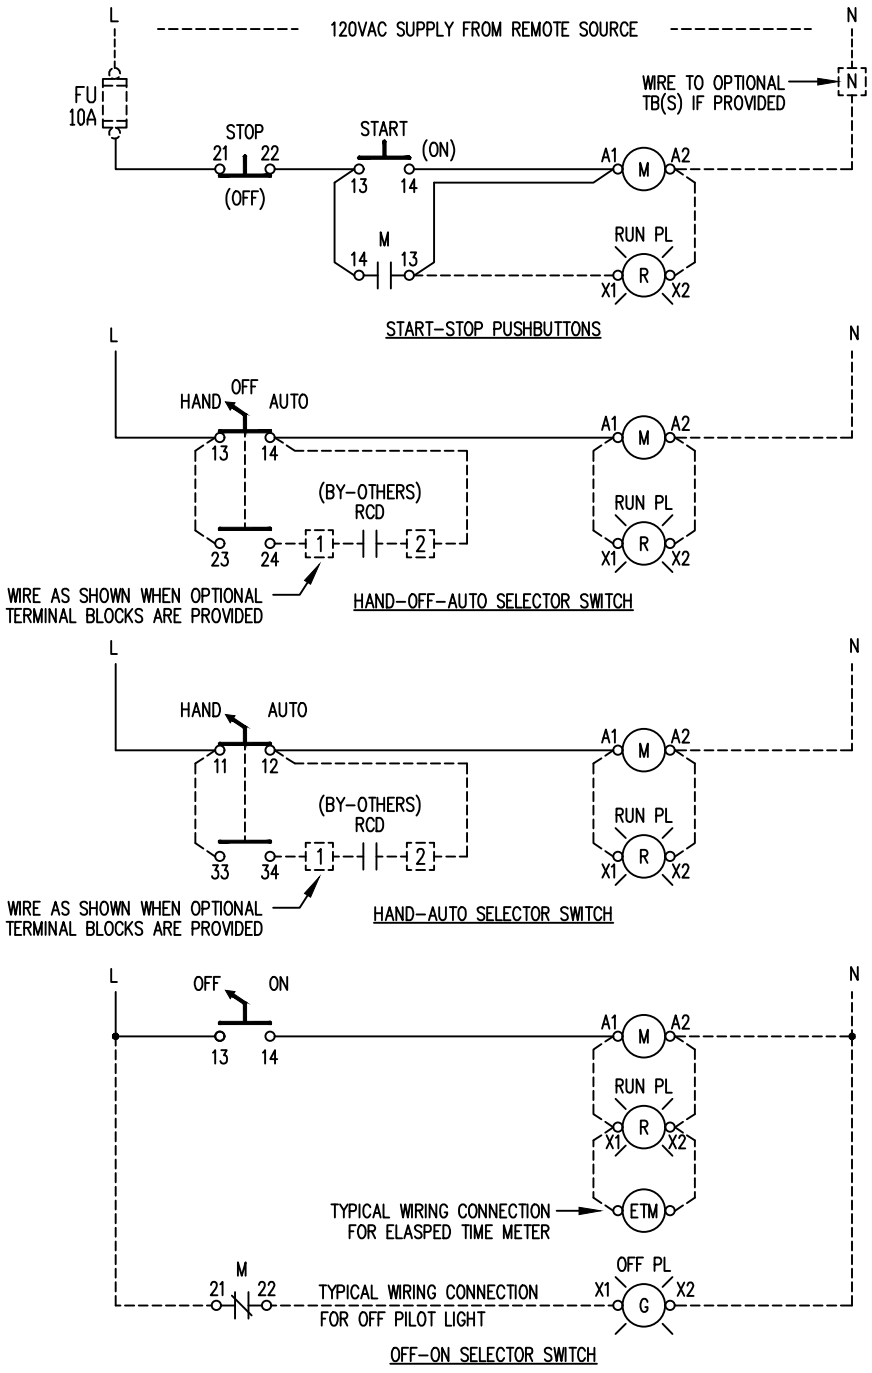

NOTES:
 1) RCD: STANDS FOR REMOTE CONTROL DEVICE BY CUSTOMER.

| REV | DESCRIPTION | DATE | APP'D |
|---------------|--|----------------------------------|--------|
| DESIGNED S+S | SERIES CA CONTACTORS FVNR W/ 120V SUPPLY FROM SEP. SOURCE THREE PHASE | sprecher+schuh HOUSTON, TEXAS | |
| DRAWN MB | | | |
| APPROVED MF | | DWG. NO. | SERIES |
| DATE 11-23-15 | | CA WS-100-03 | 100 |